
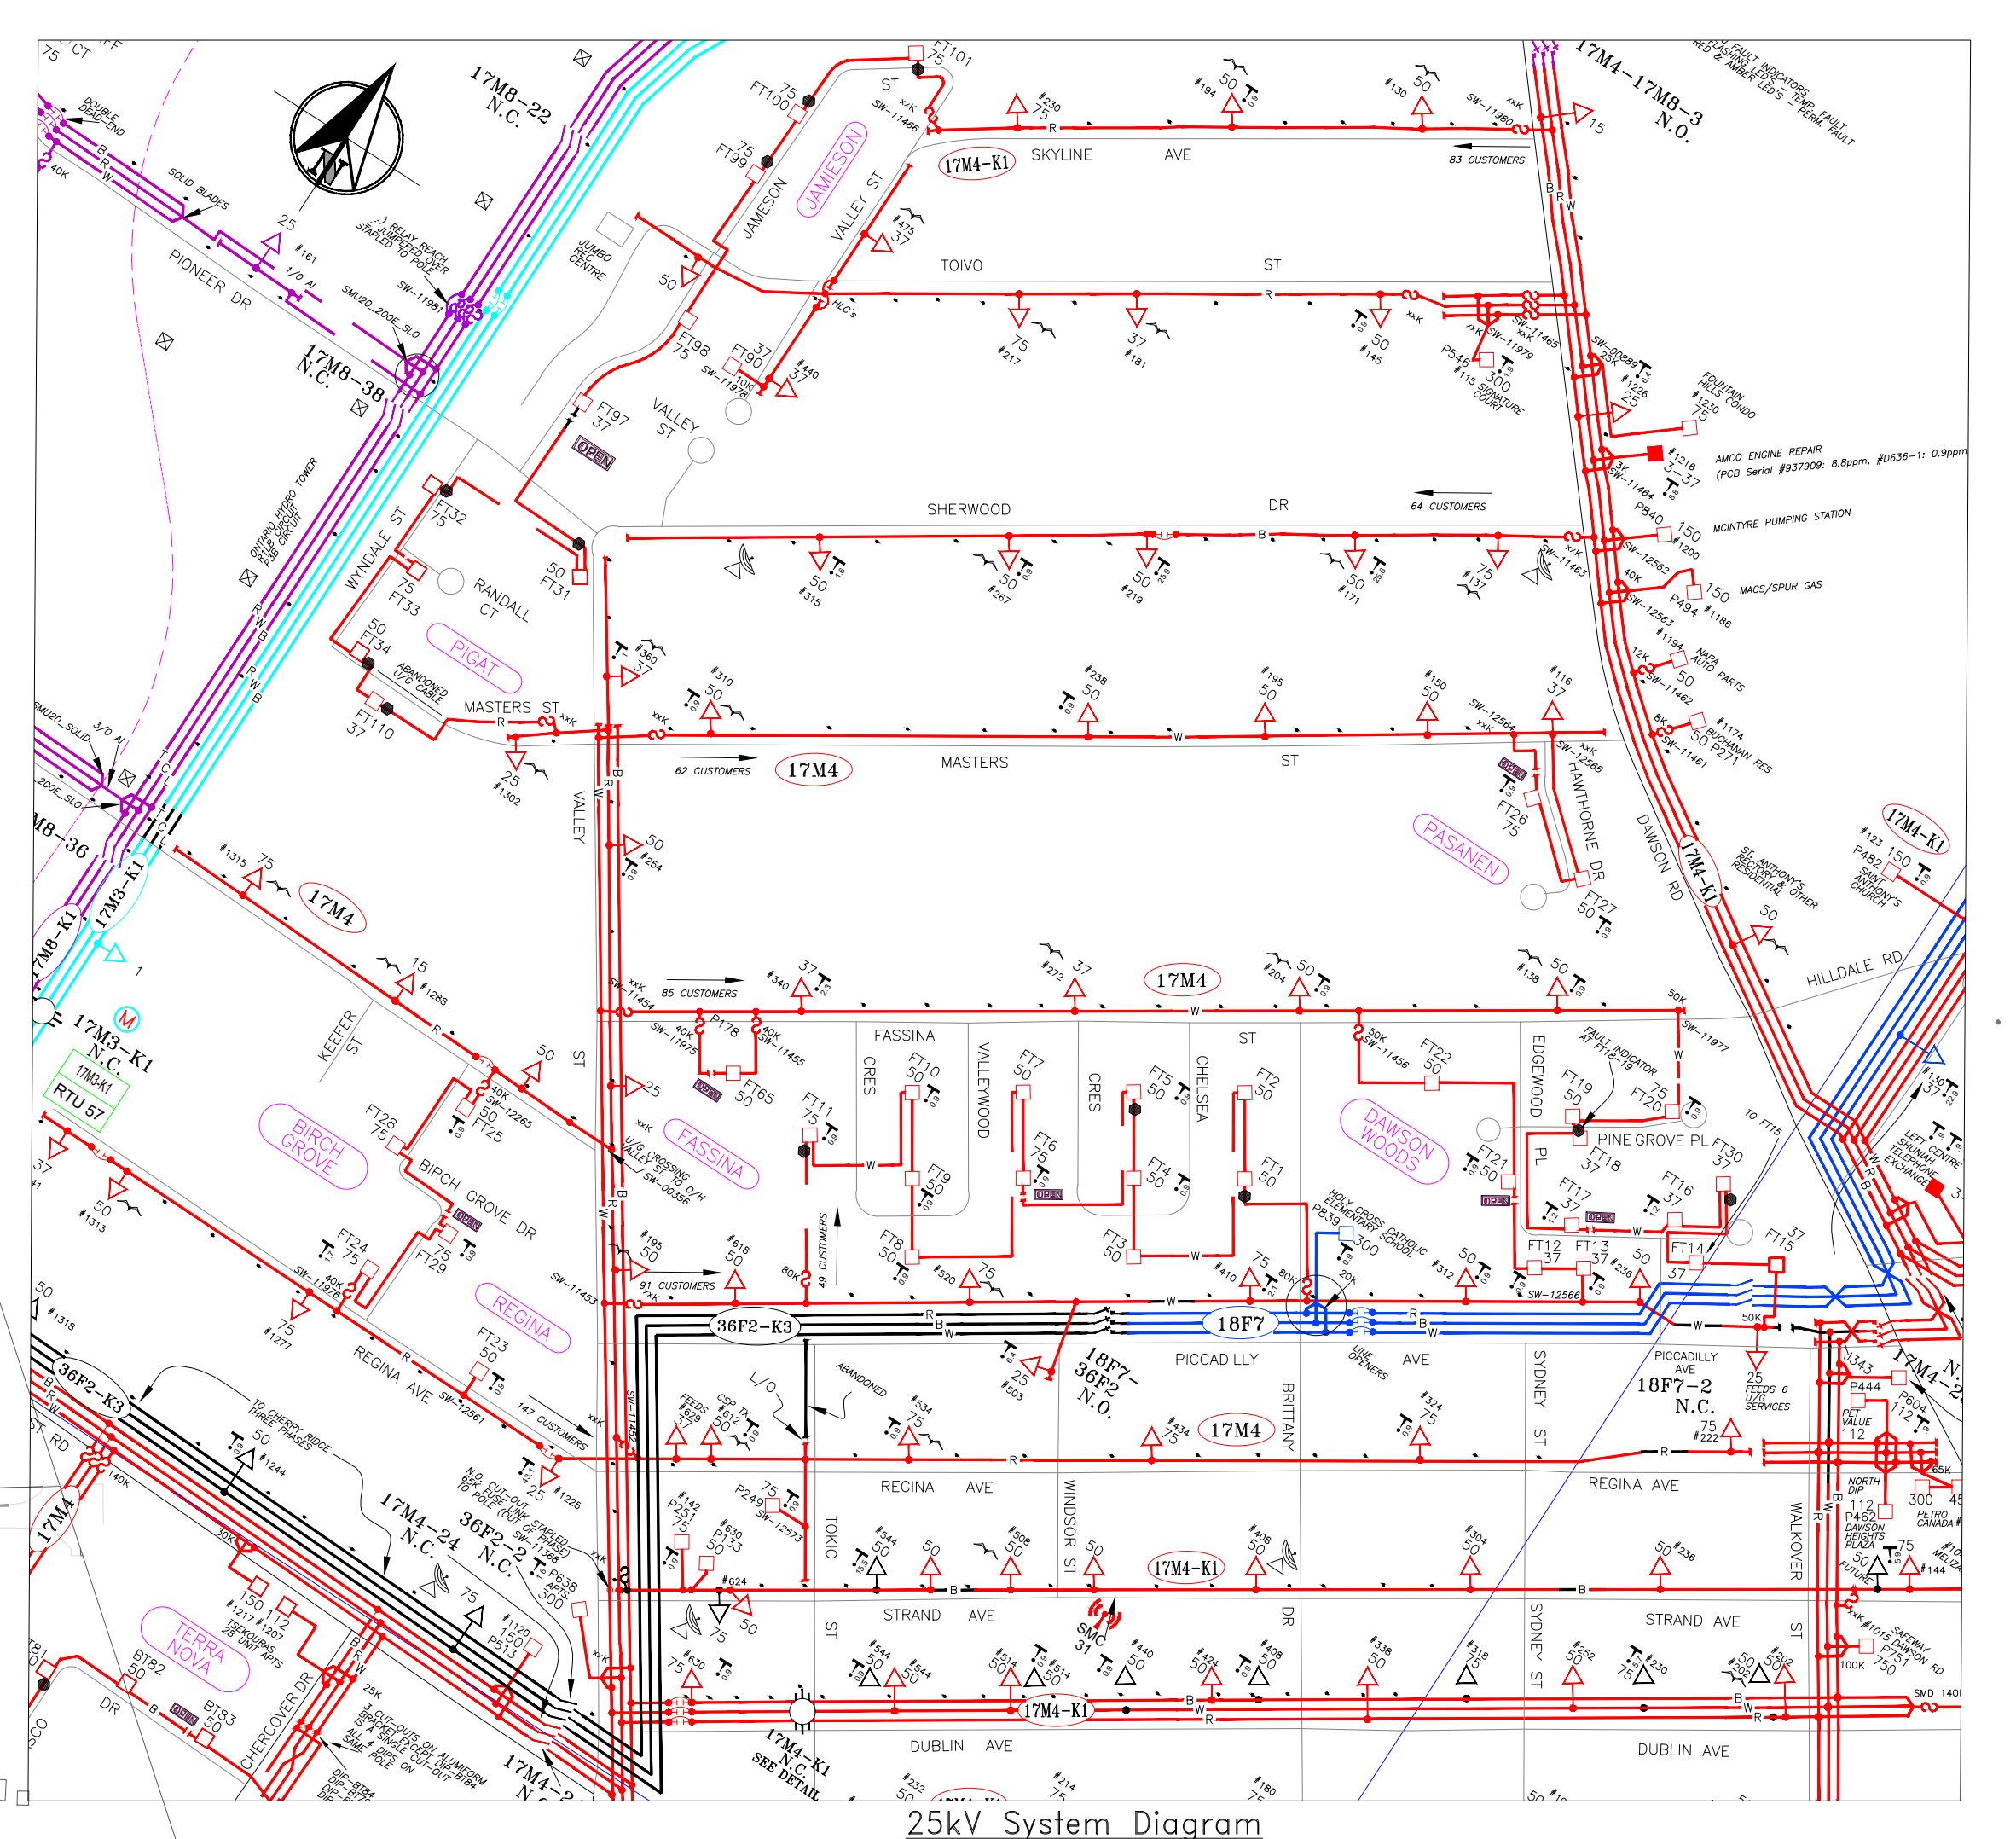


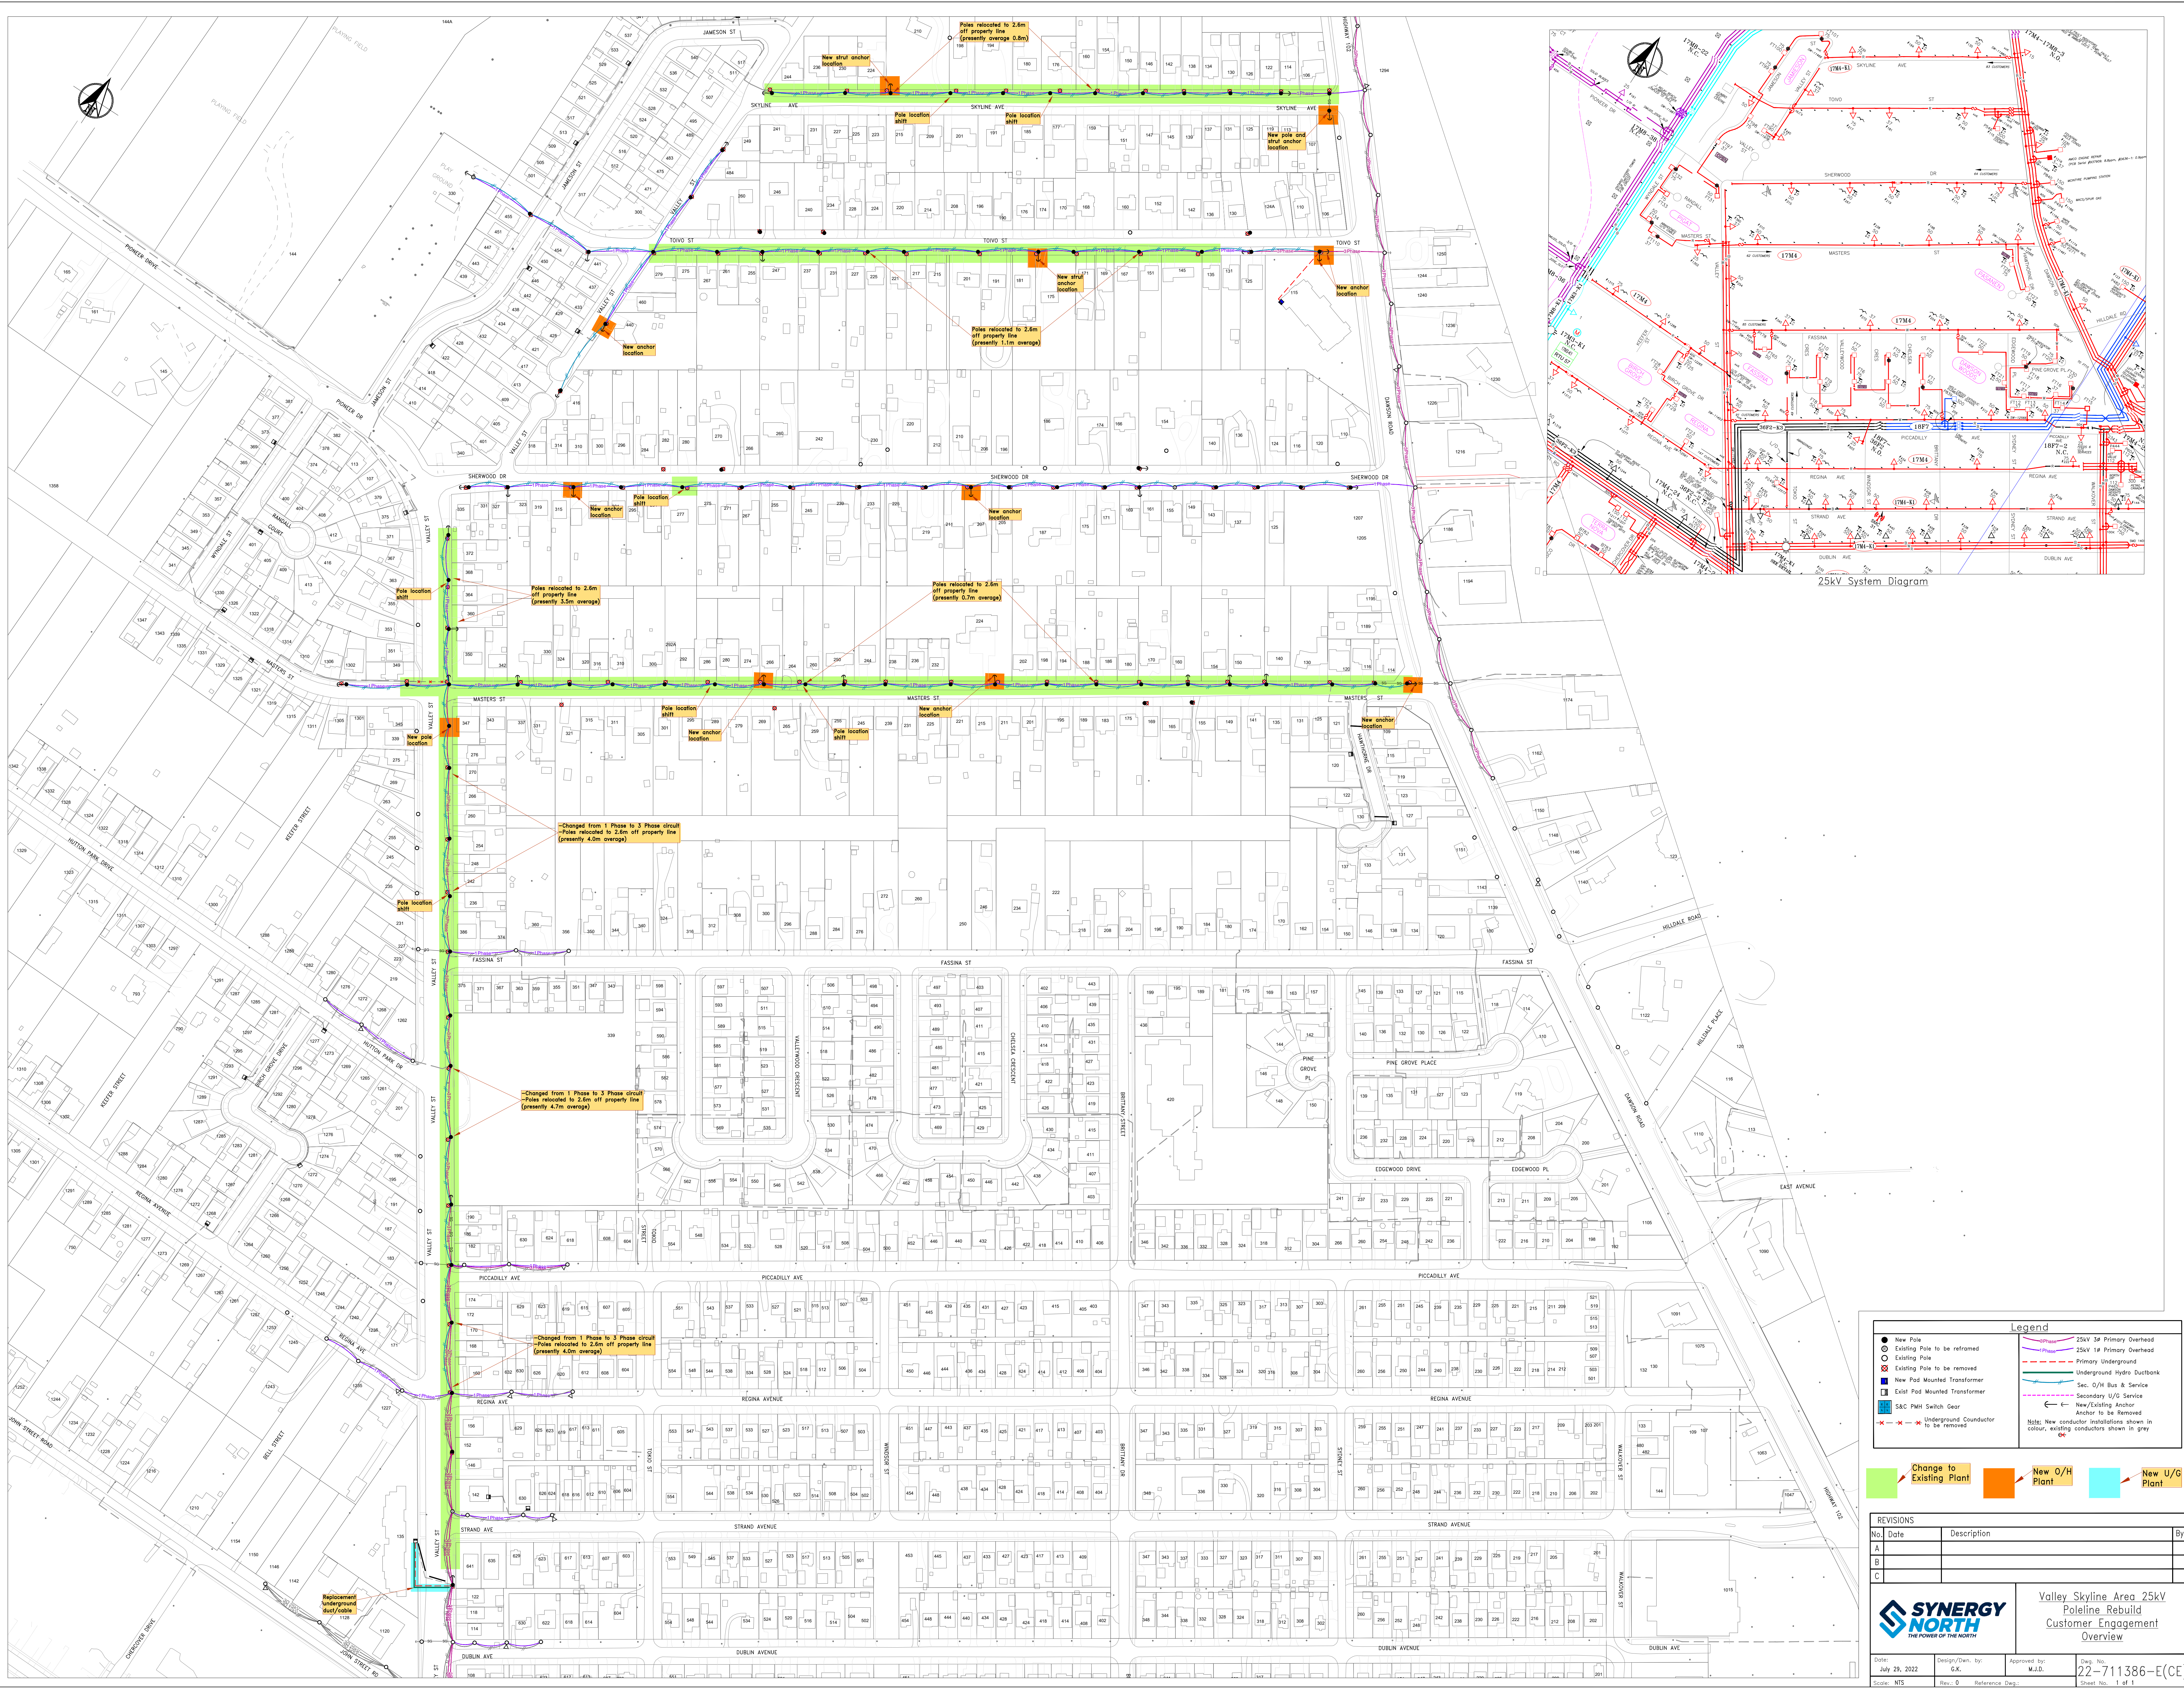

Legend

- New Pole
- Existing Pole to be reformed
- Existing Pole
- Existing Pole to be removed
- New Pad Mounted Transformer
- Exist Pad Mounted Transformer
- S&C PMH Switch Gear
- Underground Conductor to be removed
- 25kV 36 Primary Overhead
- 25kV 18 Primary Overhead
- Primary Underground
- Underground Hydro Ductbank
- Sec. O/H Bus & Service
- Secondary U/G Service
- New/Existing Anchor
- Anchor to be Removed

Note: New conductor installations shown in colour, existing conductors shown in grey

Change to Existing Plant **New O/H Plant** **New U/G Plant**

REVISIONS	No.	Date	Description	By
A				
B				
C				

SYNERGY NORTH
THE POWER OF THE NORTH

Valley Skyline Area 25kV Poleline Rebuild Customer Engagement Overview

Date: July 29, 2022 Design/Dwn. by: G.K. Approved by: M.J.D.
Scale: NTS Rev: 0 Reference: Dwg. No. 22-711386-E(CE)
Sheet No. 1 of 1