




Red River Rebuild Project

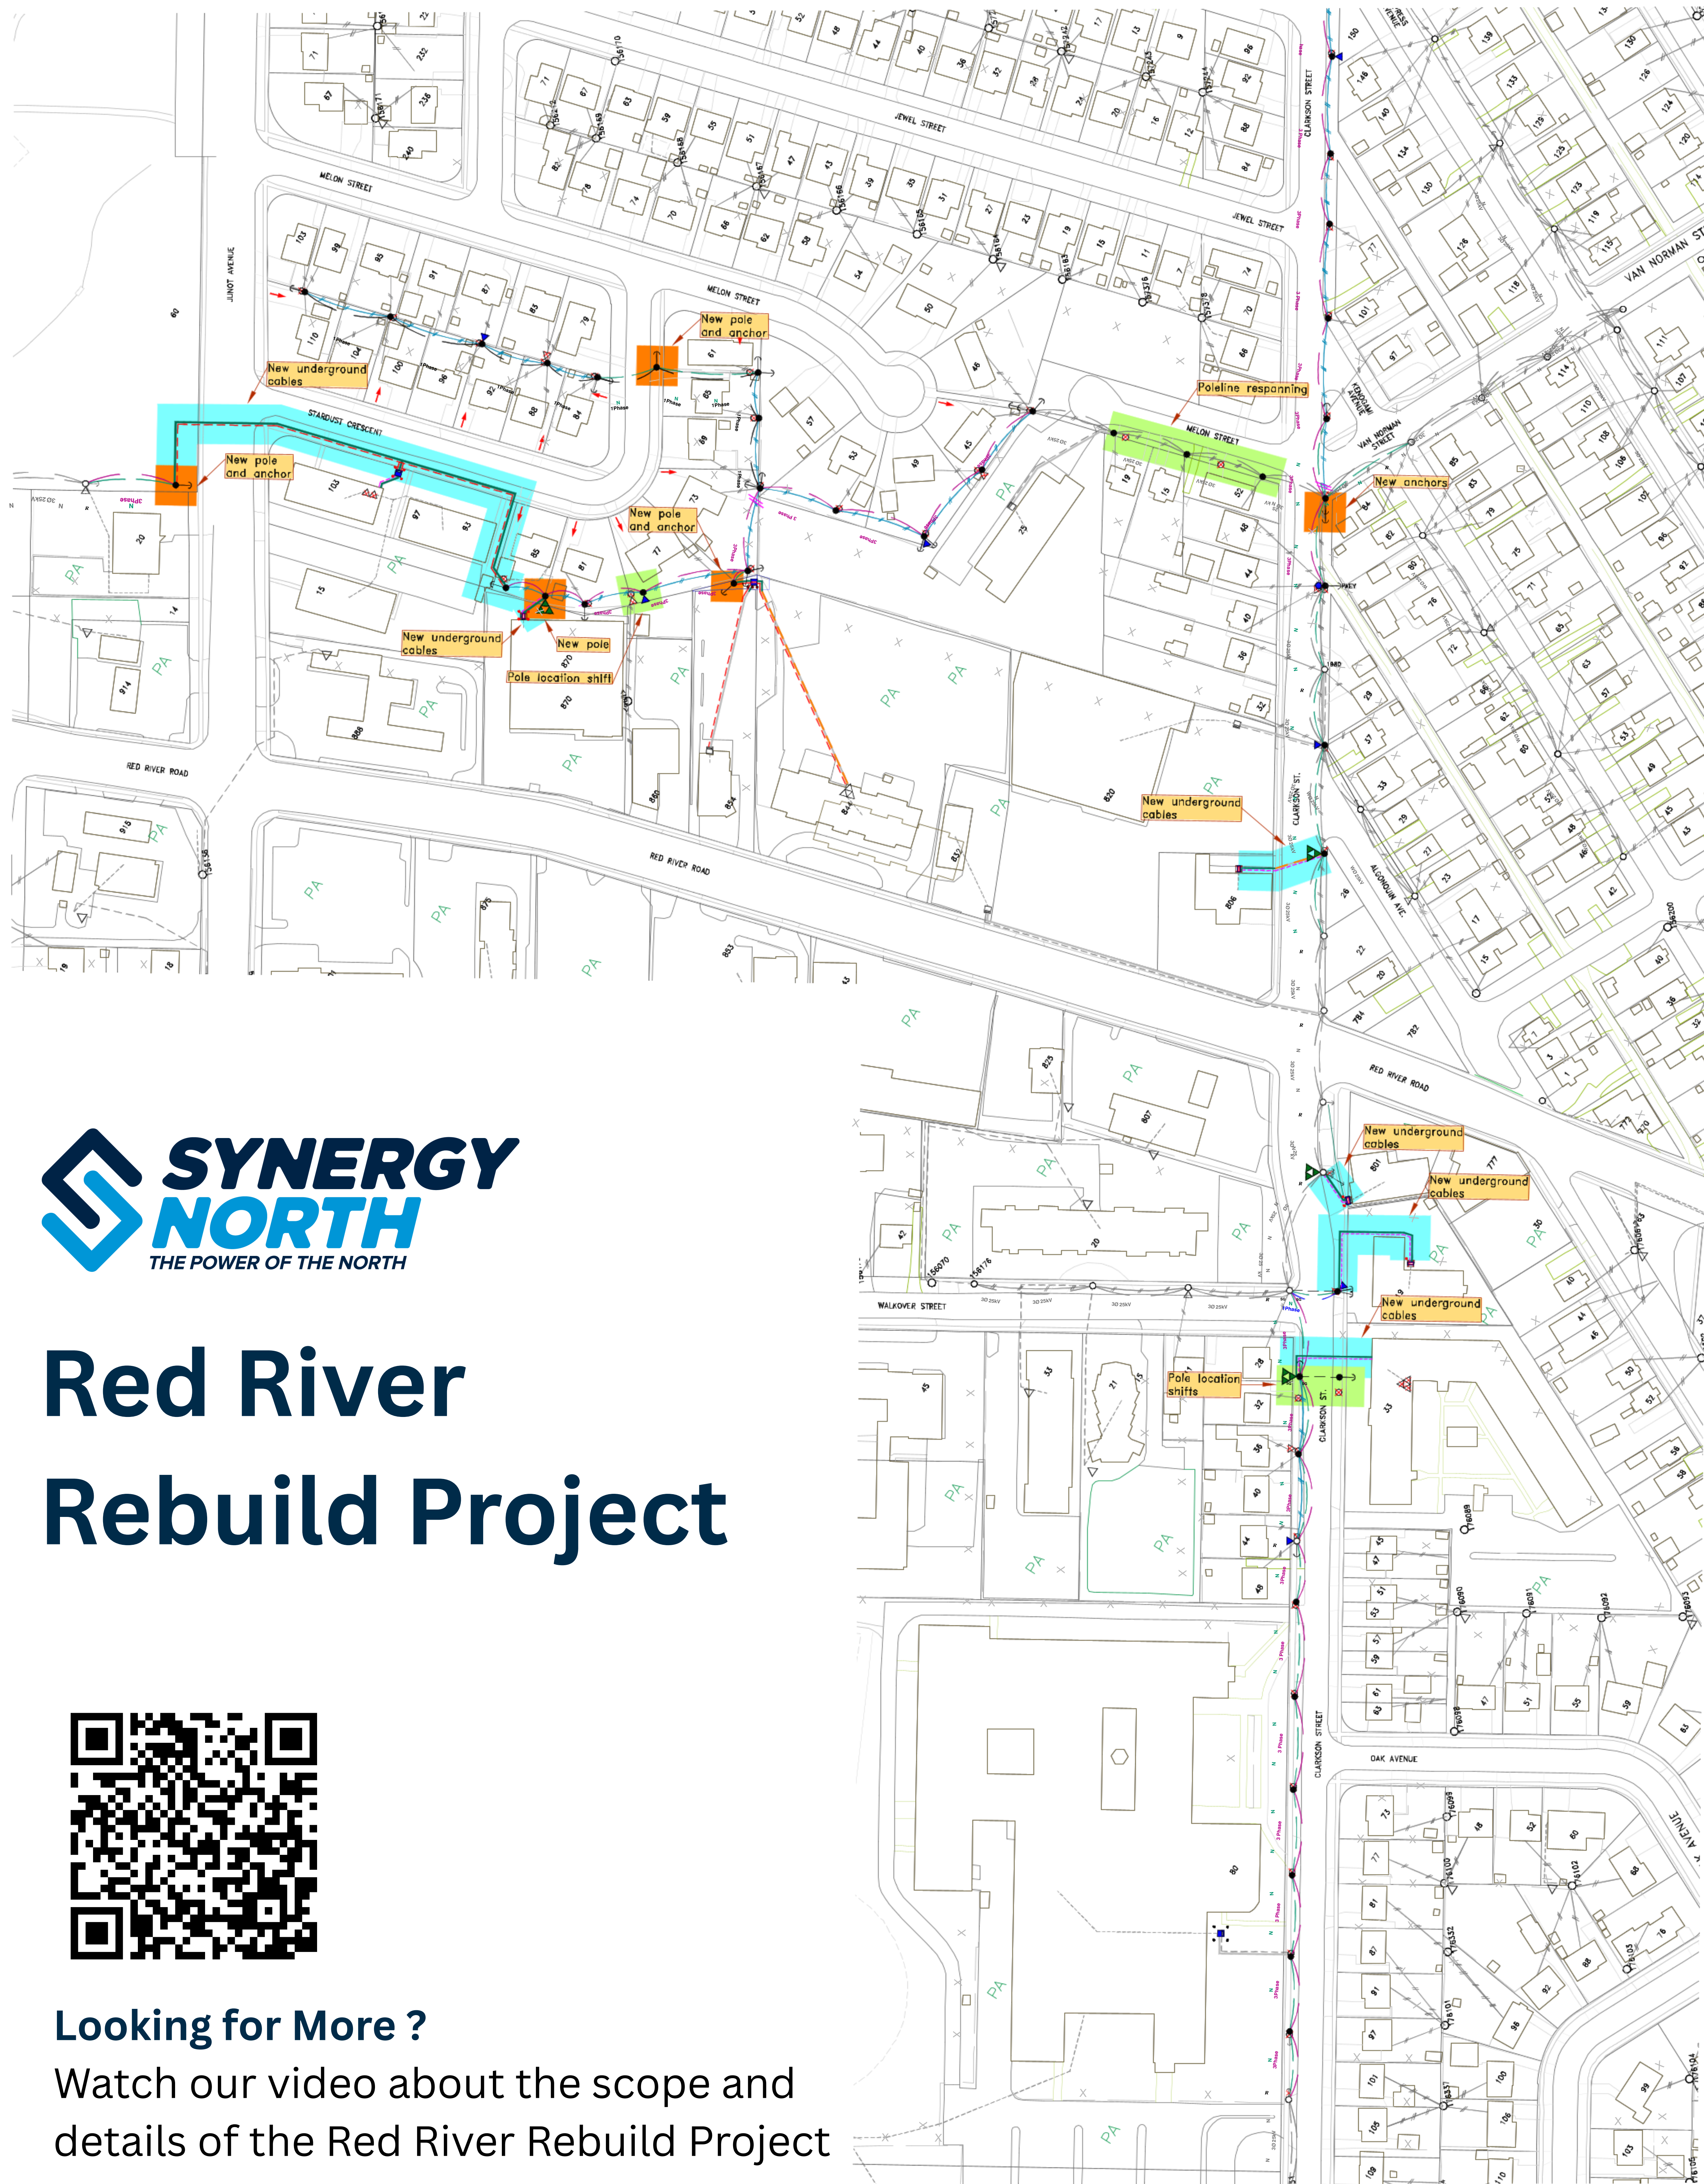

Looking for More ?

Watch our video about the scope and details of the Red River Rebuild Project

Legend	
● New Pole	— 25kV 3Ø Primary Overhead
○ Existing Pole to be reformed	— 25kV 1Ø Primary Overhead
○ Existing Pole	- - - Primary Underground
⊗ Existing Pole to be removed	— Underground Hydro Ductbank
■ New Pad Mounted Transformer	— Sec. O/H Bus & Service
□ Exist Pad Mounted Transformer	- - - Secondary U/G Service
• Guard Post	← New/Existing Anchor
	⊗ Anchor to be Removed
Note: New conductor installations shown in colour, existing conductors shown in grey	

Change to Existing Plant

New O/H Plant

New U/G Plant

Questions about this Project?

Contact our Customer Service Team:

1-833-428-1451 or

customerservice@synergynorth.ca